

DPL02

Differential pressure transducer for liquid media



Data sheet

Subject to technical changes
Issue date: 27.08.2026 • A200



» APPLICATION

Transducer for measuring differential pressure in liquid media. Typical applications include monitoring supply and return flows in heating systems, as well as monitoring filters and compressors. For easy connection, we recommend the optional connection cable with plug (see Accessories).

» TYPES AVAILABLE

	active 0..10V	active 4..20 mA
Differential pressure transducer – 0..1 bar	DPL02 1/V	DPL02 1/A
Differential pressure transducer – 0..+2,5 bar	DPL02 2,5/V	DPL02 2,5/A
Differential pressure transducer – 0..+4 bar	DPL02 4/V	DPL02 4/A
Differential pressure transducer – 0..+6 bar	DPL02 6/V	DPL02 6/A

» SECURITY ADVICE – ATTENTION

The installation and mounting of electrical devices (modules) may only be carried out by an authorized and qualified electrician.



The device is intended exclusively for its specified use. Unauthorized modifications or alterations to the device are prohibited!

The modules must not be used in connection with devices that directly or indirectly serve purposes related to human safety, health protection, or life support, or whose operation may pose a risk to people, animals, or property.

Devices with a mains power connection may only be connected when the supply line has been disconnected and is voltage-free. The following also apply:

- Local laws, health and safety regulations, technical standards, and applicable regulations
- The condition of the device at the time of installation to ensure safe installation
- This data sheet and the operating instructions of the device

» NOTES ON DISPOSAL



The symbol of the crossed-out wheeled bin indicates that the product or any removable batteries must not be disposed of with household or commercial waste.

Within the EU, you are legally obliged to ensure that the product is disposed of separately and appropriately in accordance with the applicable national regulations of your country.

Alternatively, please contact your supplier or Thermokon Sensortechnik GmbH.

Further information can be found at: www.thermokon.com

» PRODUCT TESTING AND CERTIFICATION



Declaration of conformity

Declarations of conformity for our products can be found on our website:
<https://www.thermokon.de/direct/en-gb/categories/dpl02>

» TECHNICAL DATA


Enclosure	Stainless steel V2A	
Media-contacting materials	Housing: Stainless steel Seal: EPDM	
Protection	IP65 according to EN60529	
Medium	Liquid medium	
Ambient condition	-30..+80 °C, max. 85 % rH, short term condensation	
Medium temperature range	Medium -30..+80 °C	
Measuring values	Differential pressure (static and dynamic)	
Power supply <i>(type-dependent)</i>	V 15..24 V = (±10 %) or 24 V ~ (±10 %) SELV	A 15..24 V = (±10 %) SELV
Power supply <i>when using with UD-x Display</i>	V 24 V = SELV	A 24 V = SELV
Power consumption <i>(type-dependent)</i>	V typ. 0,37 W (24 V =) 0,9 VA (24 V ~)	A max. 0,5 W
Output voltage <i>(type-dependent)</i>	V 0..10 V, min. load 10 kΩ	
Output Amp <i>(type-dependent)</i>	A 4..20 mA. max. load 850 Ω	
Connection electrical	HS MVS connector according to EN175301-803A	M12 M12 connector according to IEC 61076-2-101
Connection mechanical	G 1/4"	
Cable entry	HS Compression fitting for cable max. Ø = 5 mm (5 x 0,12 mm²)	
Weight	HS 523 g	M12 582 g
Notes	Other measuring ranges please request.	

» Differential pressure

Measuring range pressure (type-dependent)	DPL1 0..+1 bar	DPL2,5 0..+2,5 bar	DPL4 0..+4 bar	DPL6 0..+6 bar
Accuracy pressure *deviation from calibration reference device (calibrator)	<±1 % of measuring range (typ. at -5..+75 °C)			
Max. working overpressure	DPL1 2 bar	DPL2,5 5 bar	DPL4 8 bar	DPL6 12 bar

» MOUNTING ADVICE

- The device is designed for assembly on smooth walls or mounting plates.
- For connecting the device, the process lines must be unpressurized.
- The device must be secured against pressure surges by appropriate measures.
- Consider the suitability of the device for the medium to be measured.
- The device is designed for pipe mounting.
- Consider maximum pressures.
- To avoid the occurrence of interfering dead times, the pressure sensing leads shall be as small as possible and shall be laid without any sharp bends.
- With pulsating pressures on the system, function interferences of the device can be caused. As a protection, the installation of attenuating elements in the pressurized connection line is recommended.

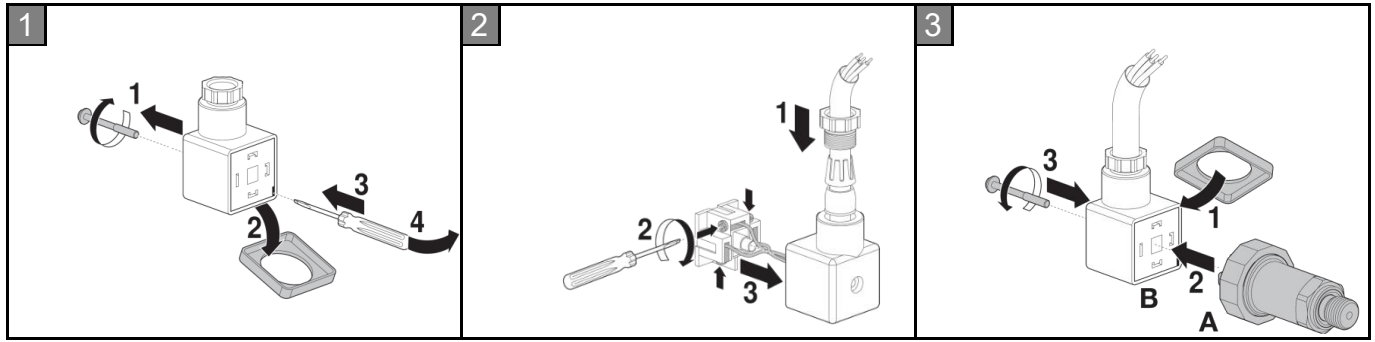


» CONNECTION PLAN

DPL02 HS

V – active 0..10 V	
1	24 V = / 24 V ~
2	GND
3	Out 0..10 V




A – active 4..20 mA	
1	24 V =
2	GND Out 4..20 mA
3	-



DPL02 M12

V – active 0..10 V	
1	24 V = / 24 V ~
2	Out 0..10 V
3	GND



A – active 4..20 mA	
1	24 V =
2	-
3	GND Out 4..20 mA

» COMMISSIONING

Static system pressure $p_{\max} = 200$ bar, pressure peaks are to be damped by design measures (capillary).

A prerequisite for the operation is a proper installation of all electrical supply, control and sensing leads as well as the pressurized connection line.

Before installing the device, the leak tightness of the pressurized connection lines must be inspected.


Pressurized sensing leads to be connected:

„+“: higher pressure


„-“: lower pressure

» DIMENSIONS (MM)

DPL02 HS

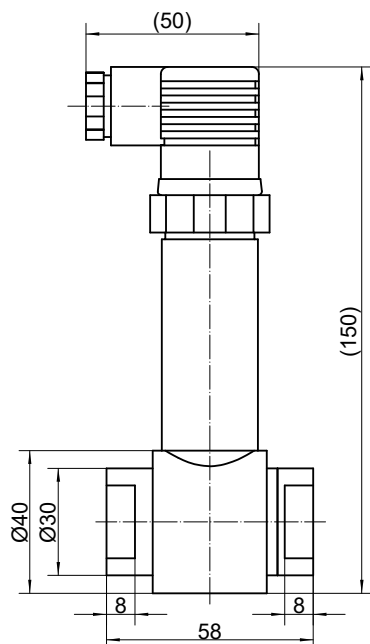

DPL02 M12

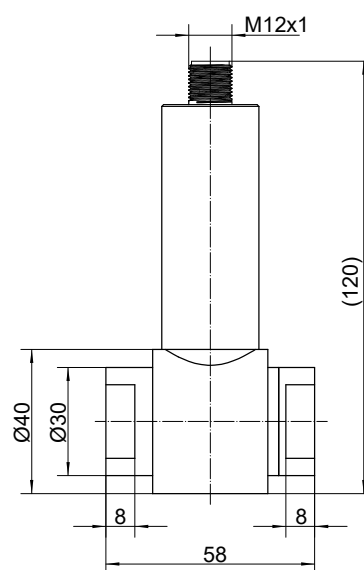

» ACCESSORIES (OPTIONAL)

Screw connection set 6mm brass (2 pcs.)
 Screw connection set 6mm stainless steel (2 pcs.)
 Screw connection set 8mm brass (2 pcs.)
 Screw connection set 8mm stainless steel (2 pcs.)

Item-No.: 373401
 Item-No.: 373388
 Item-No.: 373418
 Item-No.: 373395

Connection cable HS 2m
 Connection cable HS 5m
 Connection cable HS 10m
 Connection cable M12 2m
 Connection cable M12 5 m
 Connection cable M12 10 m

Item-No.: 809047
 Item-No.: 668309
 Item-No.: 840590
 Item-No.: 840606
 Item-No.: 840613
 Item-No.: 840620

Mounting bracket for DLF02/DPL02

Item-No.: 841375


Display UD-A (for 4...20mA device)
 Display UD-V (for 0...10V device)

Item-No.: 718189
 Item-No.: 775113

3-valve assembly for DPL02 shut-off and pressure equalization valves

Item-No.: 841368

» Recommended configuration with 3-valve assembly

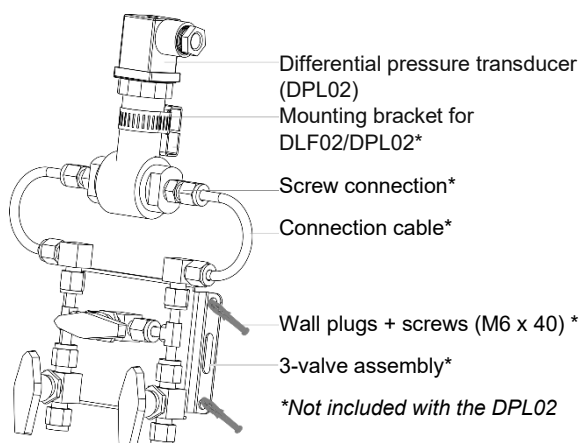

To prevent damage to the differential pressure transducer caused by water hammer, we recommend connecting it in conjunction with the 3-valve assembly (841368). This enables the valve to be disconnected from the pipework system in critical situations and the bypass to be opened. The bypass is also used to check the offset settings.